



5000B

MODEL



Networked, Secure, Data Acquisition and Logging Unit Specification Sheet

- Advanced, secure data logging and archiving
- Designed for network integration
- FTP client and server
- Ethernet and Modbus TCP comms
- Time synchronization using SNTP (server and client)
- Live, remote, data viewing and operation
- Batch functionality
- User editable screens for remote viewing
- Up to 12 universal inputs
- Up to 7 relay outputs
- 125msec parallel sampling
- Review, Configuration and Bridge software as standard
- Alarm notification via email

| Available Features |  | | |
|--------------------|--|------------------|----------|
| Input channels | Up to 12 (6 per input board) | | |
| Relays | Up to 7 (3 per relay board +1) | | |
| Events Inputs | Up to 12 (6 per input board) | | |
| Groups | Up to 6 groups | | |
| Maths channels | Up to 84 Derived channels/totalisers/counters | | |
| Timers | Up to 12 timers | | |
| Screen Builder | Up to 24 user screens | | |
| Batch | Batch data control | | |
| Auditor features | Audit trail, Electronic signing, Signature element controls | | |
| Security | Configurable access and passwords for individual user names | | |
| Alarms | Four per input/maths channel; Four per totaliser, counter, timer | | |
| Standard views | Horizontal/vertical trend, Horizontal/vertical bargraph, Numeric, Vertical Trend History | | |
| Software | Configuration | Full Bridge 5000 | Review |
| | Standard | Standard | Standard |

Data Logging & Archiving

Internal FLASH memory is used for secure data logging. This data can be archived to a remote host, either on demand, or automatically, at a configurable interval. The 5000B Archive Configuration page contains an estimate of how long it will take to fill the memory, this period being dependent on the complexity of the overall recorder configuration. Table 1 below gives some examples.

The 5000B archives over the Ethernet, providing a secure, infinite-capacity, archiving capability.

| Log/Archive Destination | Sample rate | | | | | | |
|-------------------------------|-------------|----------|----------|----------|----------|----------|----------|
| | 0.25sec | 0.5sec | 1sec | 5sec | 10secs | 30secs | 60secs |
| Log to Internal 16.25MB flash | 1 day | 5 days | 11 days | 57 days | 115 days | 345 days | 690 days |
| Archive via Ethernet | Infinite | Infinite | Infinite | Infinite | Infinite | Infinite | Infinite |

Table 1 Typical log/archive capabilities versus sample rate (1 group of six channels)

Ethernet communications

General

| | |
|---------------------|--|
| Electrical standard | 10Mbps Ethernet 10baseT (IEEE802-3) |
| Transfer protocol | Modbus TCP/IP. Provision for File Transfer Protocol (FTP) |

Batch functions

Up to six user-defined fields can be configured to cause batch-specific data to be logged with the process data. The information consists of a Field Descriptor of up to 20 characters (e.g. 'Batch number') and associated batch information of up to 60 characters (e.g.'123456').

The user can choose to log up to all six fields on either or both Batch Start and Batch Stop. The information (along with time and date) appears in the trend history for the group and cannot be separated from the process data to which it refers.

Full Bridge 5000

Full Bridge 5000 allows any PC, which meets or exceeds the minimum requirements listed below, to access and control multiple 5000B instruments.

Full Bridge 5000 software provides a powerful, easy-to-use interface, using a direct Ethernet connection, a local area network or the Internet, to allow remote configuration, operation and viewing of data. Each 5000B unit may be connected to up to four remote PCs at the same time.

Minimum PC requirements

- P90 running Windows® NT/2000
- 32 MB RAM
- 50 MB free hard disk space
- Graphics drive capable of displaying >256 colours (recommended)

© Windows 2000 and Windows NT are either Registered Trademarks or are Trademarks of Microsoft corporation in the United States and/or other countries

Time synchronization

The 5000B supports Simple Network Time Protocol (SNTP) which, when enabled, updates the instrument time every 15 minutes from the configured SNTP server. The 5000B can also act as a Unicast SNTP server on the network, allowing client instruments to synchronize with the 5000B to a resolution of one millisecond.

Auditor Features

Designed to meet the requirements of the FDA Regulation 21 CFR Part 11 for Electronic Records and Signatures, this software option provides the 5000B with additional security such as password ageing, electronic signatures and time stamped audit trail.

Modbus Master

Allows users to view data from multiple instruments connected either by a local Network connection using Modbus TCP, or a Serial connection using Modbus RTU.

Event Input

The Event Input option offers six isolated event input circuits per board fitted. Triggered externally these discrete inputs can be used to initiate internal actions within the 5000 Series Data Acquisition unit. For example they could be used to remotely start or stop a Batch.

ASCII Printer Output (Reports)

When enabled on the product the ASCII printer option provides the 5000 Series with the ability to generate up to 10 simple reports that can be directed to an ASCII text printer. Reports, triggered by an event/job can be configured to contain parameters such as time and date, batch names, process values and user defined messages.

INSTALLATION CATEGORY II

The rate impulse voltage for equipment on nominal 230V mains is 2500V.

POLLUTION DEGREE 2

Normally, only non-conductive pollution occurs. Occasionally, however, a temporary conductivity caused by condensation shall be expected.

TECHNICAL SPECIFICATION

Recorder

Environmental performance

| | | |
|------------------------------------|--------------------|-------------------------------|
| Temperature limits | Operation: | 0 to 50°C |
| | Storage: | -20 to + 70°C |
| Humidity limits | Operation/Storage: | 5% to 95% RH (non condensing) |
| Protection | | IP20 |
| Shock | | BS EN61010 |
| Vibration (BS EN60068-2-6 Test Fc) | | 2g peak |
| Altitude | | < 2000 meters |

Clock (RTC) data

| | | |
|-----------------------|--------------|-----------------|
| Temperature stability | 0 to 40°C | -3 to +2 ppm |
| | -40 to +85°C | ±7.5 ppm |
| Ageing | | ±1 ppm per year |

Electromagnetic compatibility (EMC)

Emissions and immunity BS EN61326

Electrical Safety

(BS EN61010) Installation category II; Pollution degree 2

Physical

| | |
|-----------------|--|
| Mounting method | DIN rail (T35) or wall mounted. |
| Mounting angle | Connectors to be horizontal for T/C inputs - otherwise no constraints. |
| Size | See figure on opposite page. |
| Weight | < 1.5kg |

Operator interface

Full operation, configuration and file transfer from remote PC

Power requirements

| | |
|--------------------------|-----------------------------------|
| Supply voltage | 18 to 30V dc |
| Maximum power drain | 10 Watts |
| Inrush current (maximum) | 18 Amps |
| | Eurotherm Model 5000P can be used |

Back-up Battery

| | |
|--------------------|---|
| Type | Poly-carbonmonofluoride/lithium (BR2330) Part No. PA261095 |
| Support time (RTC) | 1 year min. with recorder unpowered |
| Replacement period | 3 years |
| Stored data | Time; date; values for totalisers, counters and timers; batch data; Fvalue, Rolling average, Stopwatch etc. |

Update/archive rates

| | |
|--------------------------------|--|
| Input/relay output sample rate | 8Hz (all channels) |
| Display update | Network dependent |
| Sample value | Value at sample time |
| Trend value | Latest value at display update time |
| Calculations | 8Hz update of all alarm setpoints, maths, totaliser, counter etc. values |

Inputs

General

| | |
|----------------------------------|---|
| Input types | dc Volts, dc millivolts, dc milliamps (needs external shunt) Thermocouple, 2/3 wire RTD, Contact closure (not ch1 or 7) >60msec |
| Input type mix | Freely configurable |
| Maximum number of inputs | 12 |
| A/D conversion method | >16 bits, 2nd order delta-sigma |
| Input ranges: | See tables 2 to 5 |
| Termination | Edge connector / Terminal block |
| Noise rejection | >140dB (channel-to-channel) |
| (48 to 62 Hz) | >140dB (channel-to-ground) |
| | Series mode: >60dB |
| Maximum common mode voltage | 250 Volts continuous |
| Maximum series mode voltage | 45mV at lowest (38mV) range 12 Volts at highest (10V) range |
| Isolation* | Channel-to-channel: 300V RMS or dc (double insulation) Channel-to-common electronics: 300V RMS or dc (double insulation) Channel-to-ground: 300V RMS or dc (basic insulation) |
| Dielectric strength (BS EN61010) | (1 minute type tests) Channel-to-channel: 2500 Volts ac Channel-to-ground: 1500 Volts ac |
| Insulation resistance | >10MΩ at 500 Volts dc |
| Input impedance | 10 Volt range: 68.8kΩ All other ranges: >10MΩ |
| Overvoltage protection | 50V peak (150V peak with attenuator) |
| Open circuit | Recognition time: 500 msec |
| Current: | 57nA |
| Minimum break resistance: | 10MΩ |

TECHNICAL SPECIFICATION (continued)

Inputs (continued)

| | | |
|------------------------------------|--|-------------------------------------|
| DC input ranges | | |
| Performance | | See Table 2 |
| Shunt type | | Externally mounted resistor modules |
| Additional error due to shunt | | 0.1% of input |
| Additional error due to attenuator | | 0.2% of input |

| Low Range | High Range | Resolution | Maximum error (Instrument at 20°C) | Worst case temperature performance |
|-----------|------------|------------|------------------------------------|------------------------------------|
| -38mV | 38mV | 1.4µV | 0.085% input + 0.051% range | 80ppm of input per °C |
| -150mV | 150mV | 5.5µV | 0.084% input + 0.038% range | 80ppm of input per °C |
| -1V | 1V | 37µV | 0.084% input + 0.029% range | 80ppm of input per °C |
| -10V | 10V | 370µV | 0.275% input + 0.030% range | 272ppm of input per °C |

Table 2 DC ranges and performance

Thermocouple data

| | | |
|-------------------------|--|--|
| Types and Ranges | | See Table 3. |
| Temperature scale | | ITS90 |
| Bias current | | 0.05nA |
| Cold junction | | Types: Off, internal, external, remote |
| | | Error: 1°C max. with instrument at 25°C |
| | | Rejection ratio: 50:1 minimum |
| Upscale/downscale drive | | High, low or none selectable for each thermocouple channel |
| | | Additional error 0.01°C (typ.) if High/low selected |

| T/C Type | Overall range (°C) | Standard | Max linearisation error |
|---------------------|--------------------|---------------------------|--|
| B | 0 to +1820 | IEC 584.1 | 0 to 400°C = 1.7°C 400 to 1820°C = 0.03°C |
| C | 0 to +2300 | Hoskins | 0.12°C |
| D | 0 to +2495 | Hoskins | 0.08°C |
| E | -270 to +1000 | IEC 584.1 | 0.03°C |
| G2 | 0 to +2315 | Hoskins | 0.07°C |
| J | -210 to +1200 | IEC 584.1 | 0.02°C |
| K | -270 to +1372 | IEC 584.1 | 0.04°C |
| L | -200 to +900 | DIN43700:1985 (To IPTS68) | 0.20°C |
| N | -270 to +1300 | IEC 584.1 | 0.04°C |
| R | -50 to +1768 | IEC 584.1 | 0.04°C |
| S | -50 to +1768 | IEC 584.1 | 0.04°C |
| T | -270 to +400 | IEC 584.1 | 0.02°C |
| U | -200 to +600 | DIN43700:1985 | 0.04°C |
| NiMoNiCo | -50 to +1410 | ASTM E1751-95 | 0.06°C |
| NiNiMo | 0 to +1406 | Ipsen | 0.14°C |
| Platinel | 0 to +1370 | Engelhard | 0.02°C |
| Pt20%Rh/ Pt40%Rh | 0 to +1888 | ASTM E1751-95 | 0.07°C |

Table 3 Thermocouple types and ranges

Resistance inputs

| | | |
|------------------------------------|--|-------------------|
| Ranges (including lead resistance) | | See Table 4 |
| Accuracy and resolution | | See Table 4 |
| RTD Types | | See Table 5 |
| Temperature scale | | ITS90 |
| Influence of lead resistance | | Error: Negligible |
| | | Mismatch: 1Ω/Ω |

| Low Range | High Range | Resolution | Maximum error (Instrument at 20°C) | Worst case temperature performance |
|-----------|------------|------------|------------------------------------|------------------------------------|
| 0Ω | 150Ω | 5mΩ | 0.045% input + 0.110% range | 35ppm of input per °C |
| 0Ω | 600Ω | 22mΩ | 0.045% input + 0.065% range | 35ppm of input per °C |
| 0Ω | 6000Ω | 148mΩ | 0.049% input + 0.035% range | 35ppm of input per °C |

Table 4 Resistance ranges – accuracy and resolution


| RTD Type | Overall range (°C) | Standard | Max linearisation error (4102C, 4102M only) |
|----------|--------------------|------------------------|---|
| Cu10 | -20 to +400 | General Electric Co. | 0.02°C |
| Cu53 | -70 to +200 | RC21-4-1966 | <0.01°C |
| JPT100 | -220 to +630 | JIS C 1604:1989 | 0.01°C |
| Ni1000 | -60 to +250 | DIN43760:1987 | 0.01°C |
| Ni1120 | -50 to +170 | DIN43760:1987 | 0.01°C |
| Pt100 | -200 to +850 | IEC 751 | 0.01°C |
| Pt100A | -200 to +600 | Eurotherm Recorders SA | 0.09°C |
| Pt1000 | -200 to +850 | IEC 751 | 0.01°C |

Table 5 Resistance thermometer types and ranges


Relay Outputs

| | |
|----------------------------------|--|
| Number of relays fitted | Standard: 1 |
| | Optional: Up to 2 boards, each with 3 relays |
| Termination | Edge connector / Terminal block |
| Maximum ac switching power* | 500VA |
| Maximum ac breaking current* | 2A within above power ratings |
| Maximum ac contact voltage* | 250V within above power ratings |
| Maximum dc power/current/voltage | See graph 2. |
| Isolation† | Relay-to-relay: 300V RMS or dc (double insulation) |
| | Relay-to-ground: 300V RMS or dc (basic insulation) |

* With resistive loads. With inductive loads, derate according to Graph 1, in which:
Contact life = resistive life x F1 or F2 where
F1 = measured on representative examples and
F2 = typical values according to experience

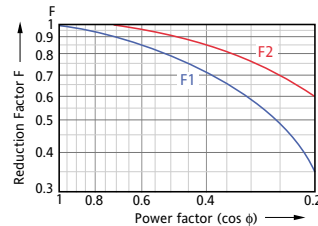

Graph 1 Derating curves



Graph 2 DC ratings

Event Input

| | |
|-----------------------|--|
| Number of inputs | 6 discrete inputs |
| Maximum No. of boards | 2 |
| Isolation | Event input to ground: 100V RMS or dc (double insulation) |
| | Event input to Event input: 0V |
| Recognition levels | Low: -30V to +0.8V |
| | High: 2 to 30V |
| Maximum frequency | 8Hz |
| Minimum pulse width | 62.5ms |
| Contact resistance | Event: Active if resistance <35KΩ Inactive if resistance >200KΩ Status not defined if 35KΩ < resistance <200KΩ between input terminal and 'C' terminal |

Serial Communications

(Typical applications: Input of ASCII string inputs from Bar-code readers, credit card readers, Modbus etc.)

ASCII Printer

ASCII Printer support

Isolation†

Terminals to ground: 100V RMS or dc (basic insulation)


† All isolation figures are:

DC to 65Hz; BS EN61010 Installation category II; Pollution degree 2:


Transmission standard

EIA232 or EIA485

MECHANICAL INSTALLATION

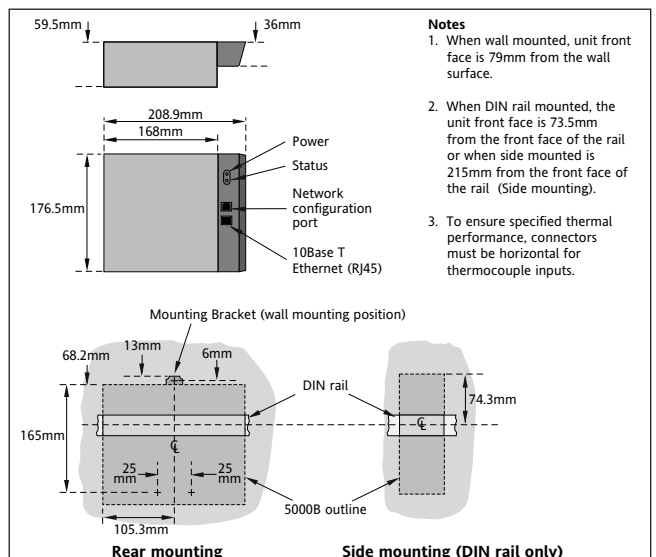


EVENT BOARD WIRING

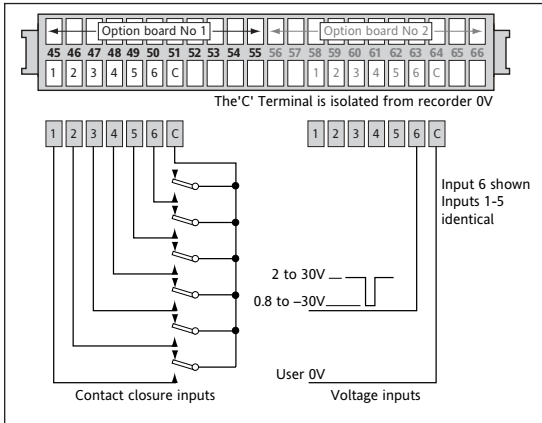


Notes

- Channels 7 to 12 (if fitted) occupy option board slots 1 and 2
- Relay board 1 fitted as standard
- Relay boards 1 and 2 (if fitted occupy option board slots 1 and 2 respectively)
- Event boards (as relay)


COMMUNICATIONS OPTION WIRING

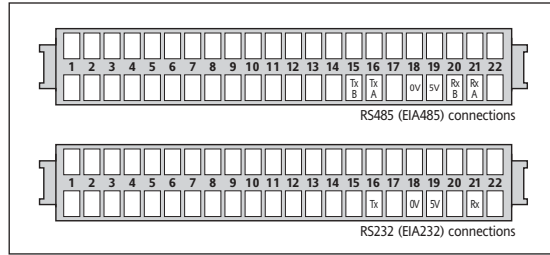


RELAY BOARD WIRING

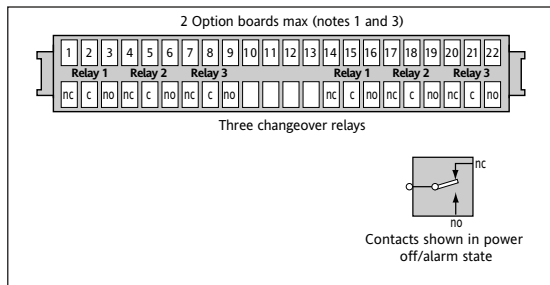

REMOTE ACCESS UNITS

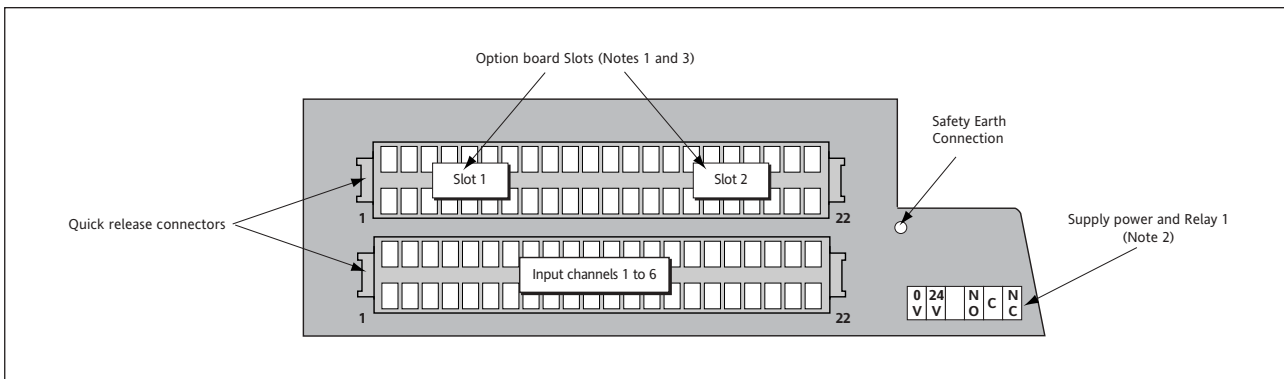

INPUT BOARD SIGNAL WIRING

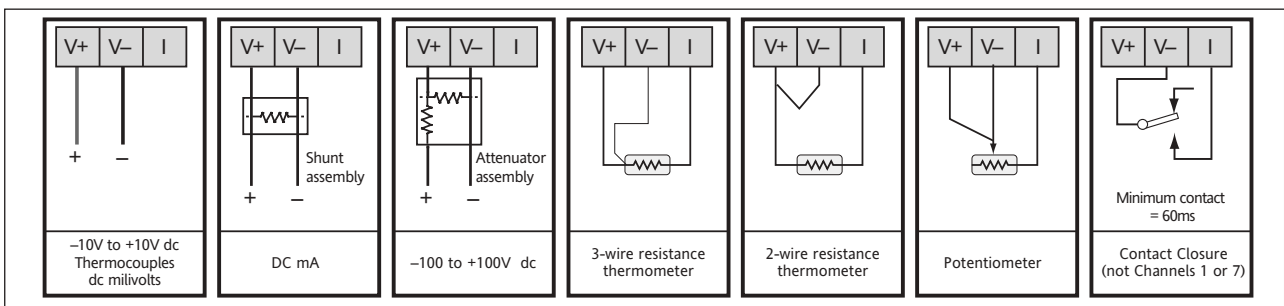

EUROTHERM LIMITED UK

Faraday Close Durrington Worthing BN13 3PL
Tel. +44 (0)1903 268500 Fax +44 (0)1903 265982
Email info@eurotherm.co.uk
www.eurotherm.co.uk

EUROTHERM US

741-F Miller Drive Leesburg VA 20175-8993
Tel. 1-703-443-0000 Fax 1-703-669-1300
Email info@eurotherm.com
www.eurotherm.com

EUROTHERM WORLDWIDE

For contact details in other countries please use:
www.eurotherm.co.uk

© Copyright Eurotherm Limited 2005

All rights are strictly reserved. No part of this document may be reproduced, modified, or transmitted in any form by any means, nor may it be stored in a retrieval system other than for the purpose to act as an aid in operating the equipment to which the document relates, without the prior written permission of Eurotherm limited.

Eurotherm Limited pursues a policy of continuous development and product improvement. The specifications in this document may therefore be changed without notice. The information in this document is given in good faith, but is intended for guidance only. Eurotherm Limited will accept no responsibility for any losses arising from errors in this document.

